




GENERAL NOTES:

1. CONTRACTION JOINTS SHALL BE PLACED EVERY 5' AND MATCH CURB JOINTS WHEN ADJACENT TO CURB.
2. 3/8" EXPANSION JOINTS SHALL BE PLACED EVERY 20' WITH FELT EXPANSION MATERIAL EXTENDING THE FULL SIDEWALK DEPTH.
3. 3/8" EXPANSION MATERIAL SHALL BE REQUIRED BETWEEN SIDEWALK AND DRIVEWAYS AND/OR DRIVEWAY APPROACH. EXPANSION JOINT MATERIAL SHALL BE SECURED IN PLACE PRIOR TO CONCRETE PLACEMENT AND SHALL COMPLETELY SEPARATE ADJACENT SLABS EXTENDING FROM THE SURFACE TO GRAVEL BASE. PLACEMENT OF EXPANSION JOINT MATERIAL SHALL NOT BE FLOATED OR PRESSED INTO WET CONCRETE AFTER CONCRETE HAS BEEN PLACED.
4. SIDEWALK SHALL SLOPE TOWARDS THE CURB AT 1% TO 2% MAX.
5. SIDEWALKS SHALL BE 6 INCHES IN DEPTH WITHIN CURB RETURNS OF ALL INTERSECTIONS CLASSIFIED AS ARTERIALS OR COLLECTORS. SIDEWALKS SHALL BE 6 INCHES IN DEPTH AS PART OF A DRIVEWAY. SIDEWALKS SHALL BE A MINIMUM OF 4 INCHES IN DEPTH AT ALL OTHER LOCATIONS.
6. STREET SIDE TOP OF WALK SHALL BE LEVEL WITH TOP OF CURB. WHERE TYPE 'S' CURBING IS USED WITH SEPARATED SIDEWALKS AND SWALES, THE STREET SIDE TOP OF WALK SHALL BE SET LEVEL WITH THE STREET SIDE TOP OF TYPE 'S' CURB.
7. SUBGRADE AND CSTM UNDER ALL SIDEWALKS SHALL BE COMPAKTED TO 95%.
8. REFER TO TABLES 7.2 & 7.3 IN THE SPOKANE VALLEY STREET STANDARDS FOR SIDEWALK WIDTH.
9. MAXIMUM LONGITUDINAL GRADE OF SIDEWALK IS 5% OR MATCH STREET GRADE, IF ADJACENT.
10. CEMENT CONCRETE SHALL BE CLASS 4,000 CONCRETE PER SECTION 6-02 OF THE WSDOT STANDARD SPECIFICATIONS.
11. ALL BROKEN, CRACKED, HEAVED AND SUNKEN CONCRETE FLATWORK SHALL BE REMOVED AND REPLACED FROM JOINT TO JOINT.
12. EXCEPT FOR JOINTS AND BROOM FINISHING, NO OTHER MARKINGS ARE PERMITTED ON THE WALKING SURFACE.
13. ALL PANEL SHALL BE TROWELED WITH A 3/8" TO 1/2" RADIUS.
14. PERIMETER EDGING SHALL NOT BE ALLOWED UNLESS IT IS FOR A REPAIR/REPLACEMENT OF EXISTING PANELS AND ONLY WHEN MATCHING ADJACENT PANELS. CONTRACTOR SHALL MAKE AN EFFORT TO MATCH EXISTING PANELS IN ACCORDANCE WITH DIRECTION FROM CITY INSPECTOR.

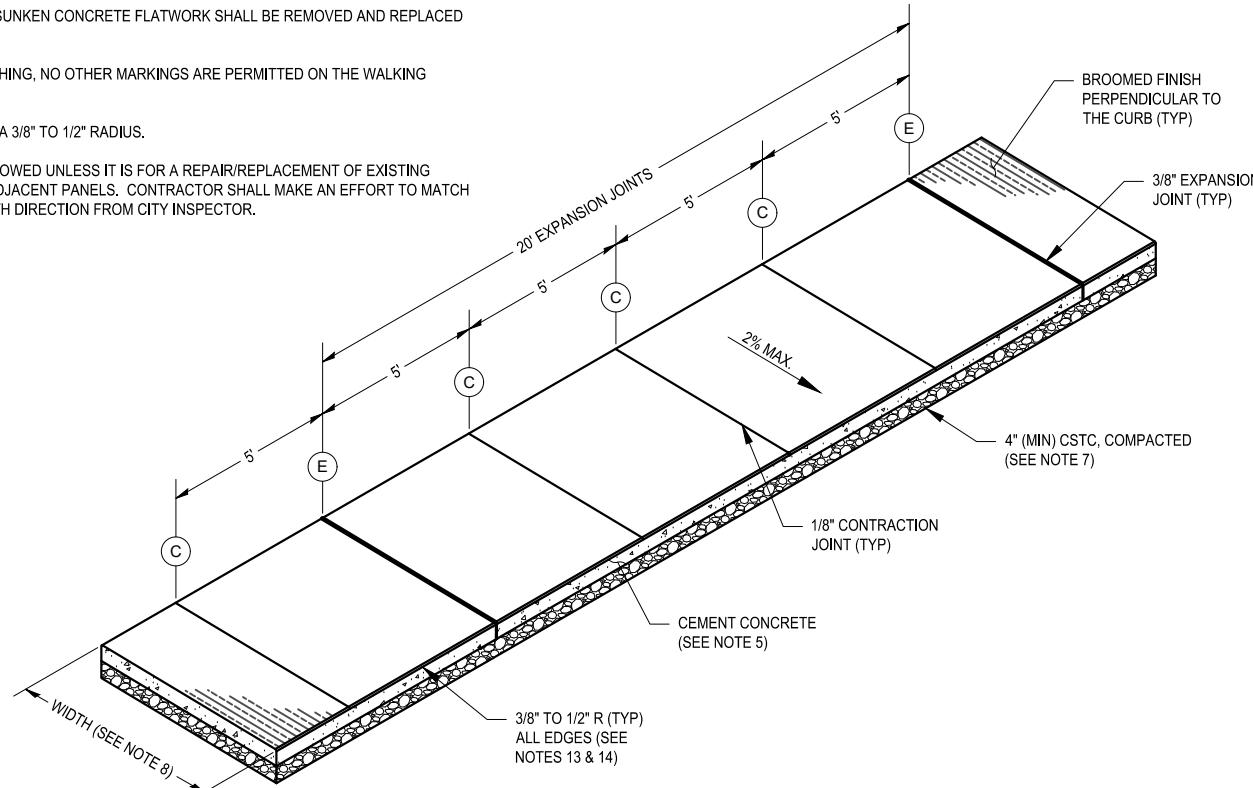

E EXPANSION JOINT DETAIL

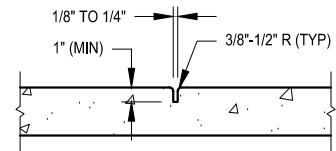

C CONTRACTION JOINT DETAIL



APPROVED BY:


ROBERT B. BLEGEN, P.E.
PUBLIC WORKS DIRECTOR

SIDEWALK

STANDARD PLAN NO.
R-103

PUBLICATION DATE: 03/2025
REVISION NO.: 02